CONFIDENTIAL

ALL RELAYS HAVE MANUAL OVERRIDE & INDICATORS


INDEX	ITEM NO	ED	AMENDMENT	DATE	SIGN

TR-EM-208 CONTROLLER CARD

commands commands

3 24V | 4 0V | 5 0v | 6 open | 7 Close | + 1 | — 2

DIP SWITCH SETTINGS ON TREM 208 CARD
REFER TO DATA SHEET
SWITCH 4 - OFF
SWITCH 3 - OFF
SWITCH 2 - OFF
SWITCH 1 - ON
CURRENT LIMIT FINE ADJUSTMENT SET AT MID POINT (7A)
START RAMP FINE ADJUSTMENT SET AT MAXIMUM CLOCKWISE (3 SECS)
STOP RAMP FINE ADJUSTMENT SET AT MINIMUM ANTICLOCKWISE (0 SECS)

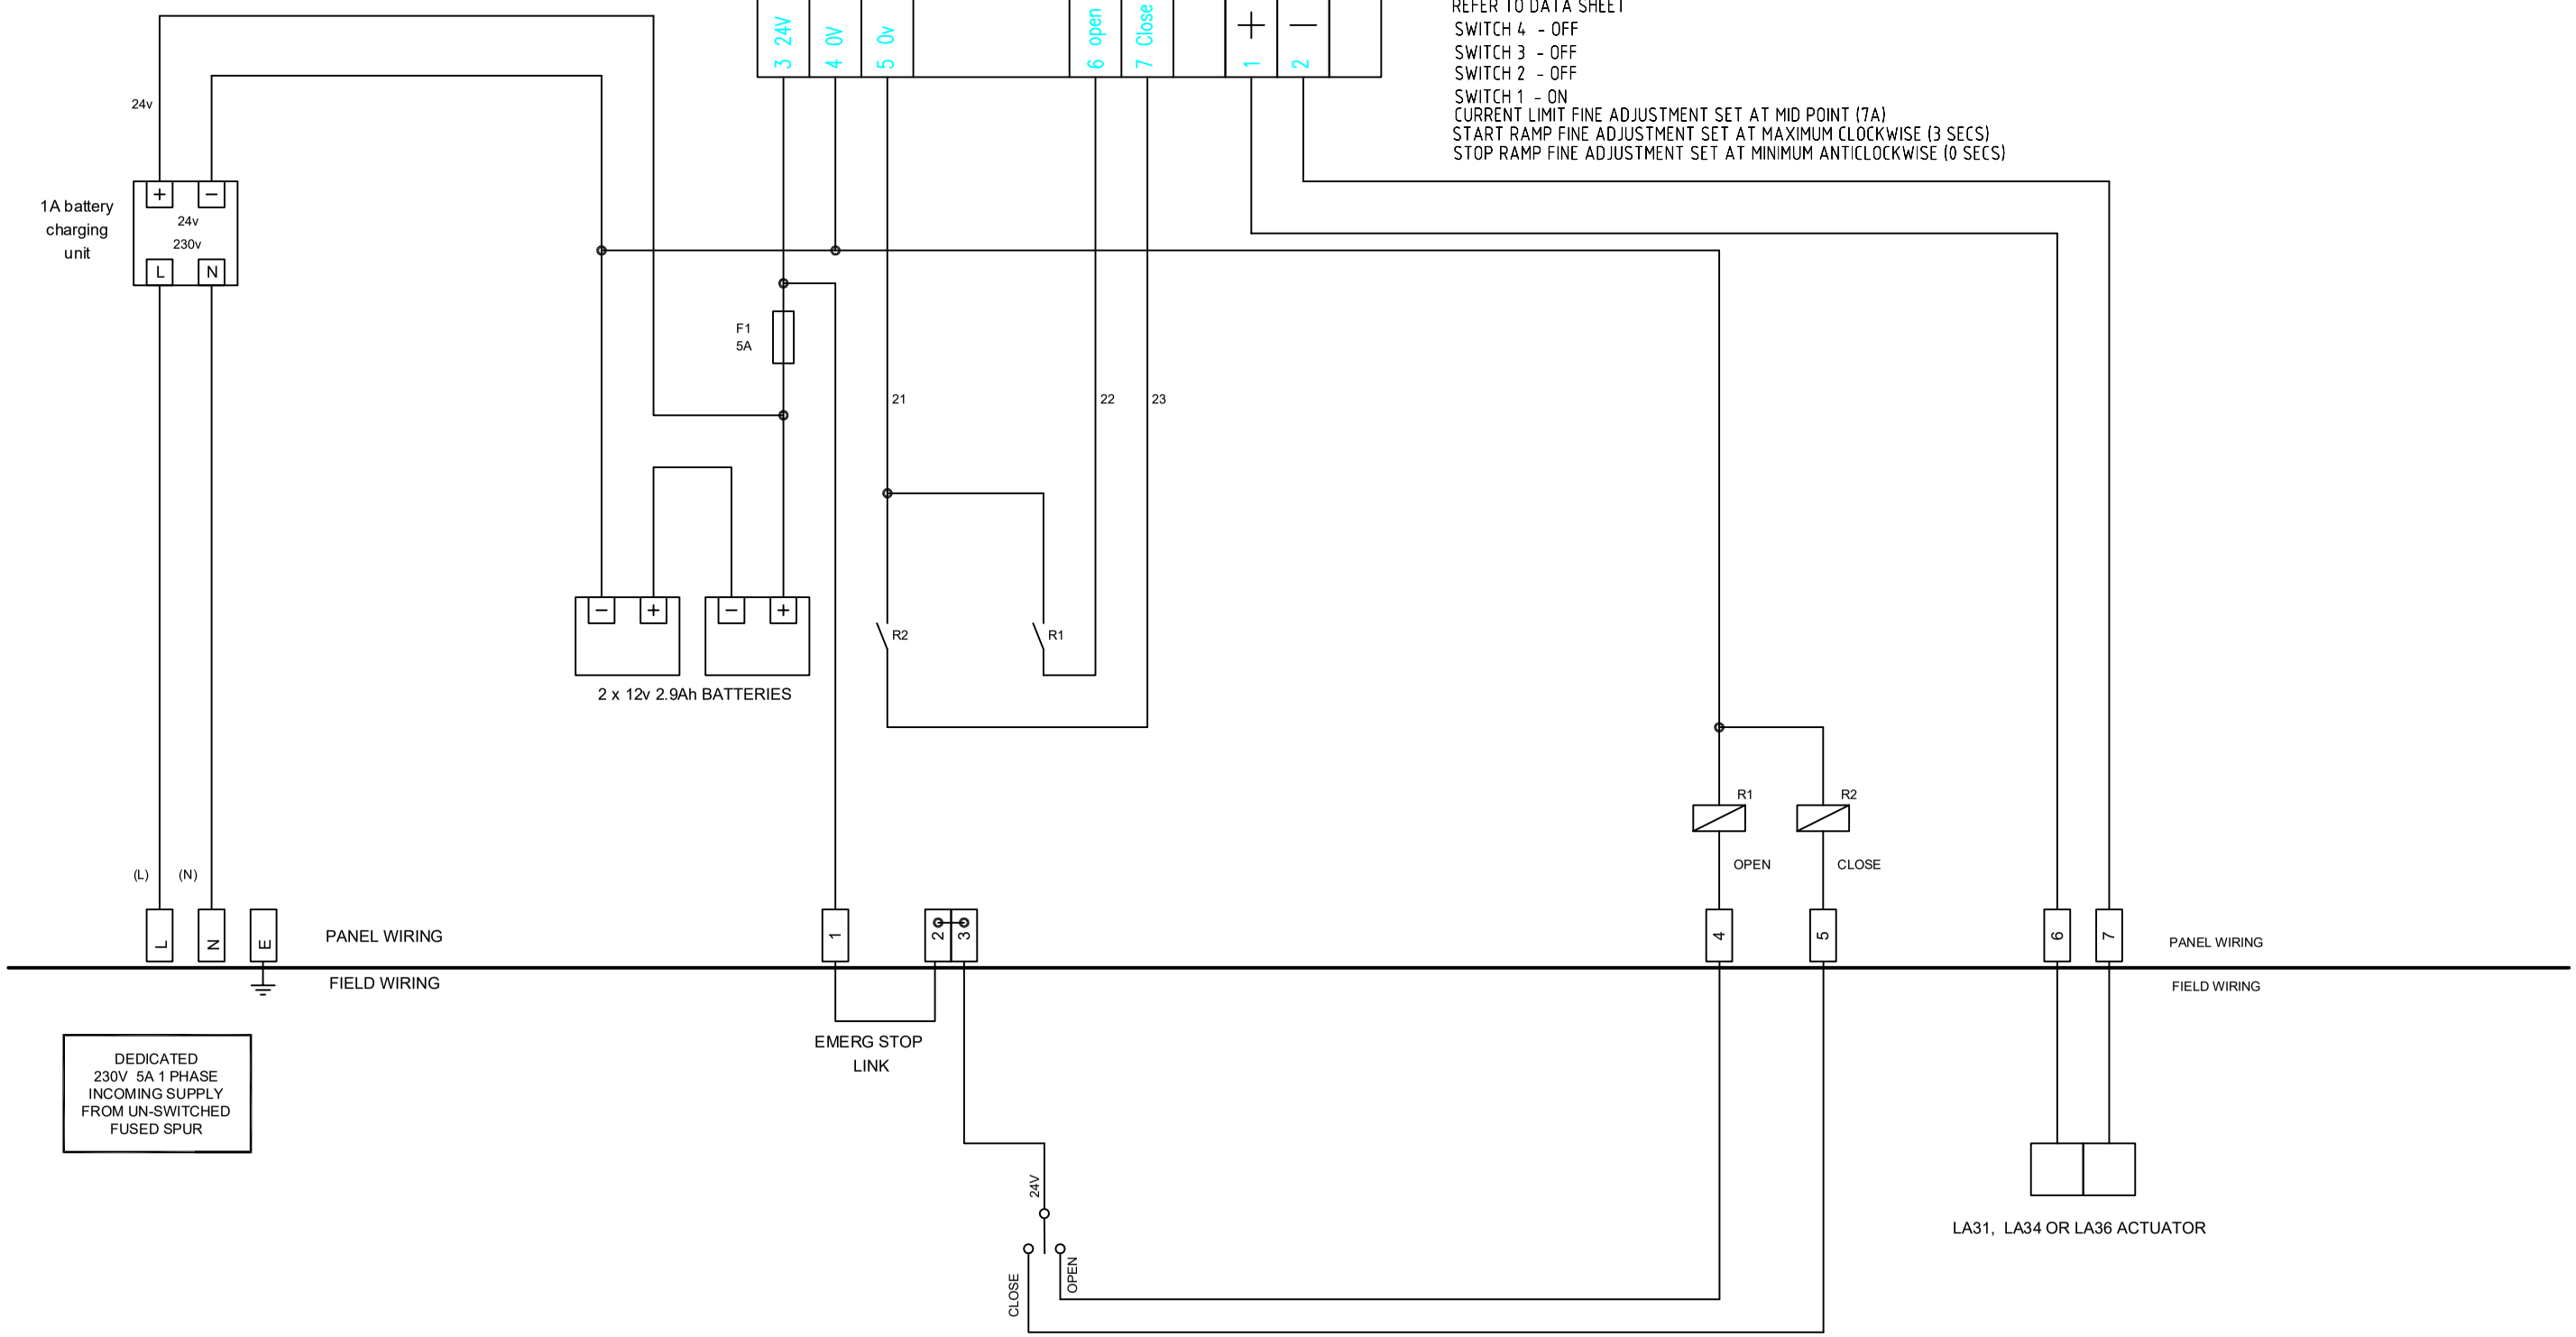

DEDICATED
230V 5A 1 PHASE
INCOMING SUPPLY
FROM UN-SWITCHED
FUSED SPUR

ENCLOSURE IS POLYCARNONATE
286MM X 235MM X 110MM HIGH

SHEET 1 OF 1 SHEETS

ITEM NO	NO OFF	DRG NO.	ITEM MASS	DENOMINATION	MATERIAL	REMARKS
				-		

Existing law protects SURESPAN'S right of possession to this drawing. The design or the drawing must not, without permission of the company, be published, copied, reproduced, manufactured or exploited in any other unauthorized way.

Single actuator
Electrical Circuit

DRAWN BY	ST
DRAWN DATE	120423

SURESPAN

CONTRACT NO.	DRAWING NO.	REV No
	SP1182/A	-

BEFORE AND DURING ALL MOVEMENTS OF THE ACCESS HATCH
ALWAYS ENSURE THAT THE AREA IN WHICH THE EQUIPMENT WILL MOVE
IS CLEAR OF ALL OBSTRUCTIONS AND PERSONNEL

REFER TO DATA SHEETS FOR ACTUATOR & CONTROL CARDS

DRAWING MADE BY CAD
MANUAL CHANGES PROHIBITED