CONFIDENTIAL

INDEX	ITEM NO	ED	AMENDMENT	DATE	SIGN
		B	ACTUATOR WIRING COLOURS	120625	ST

SUPPLY STATUS


mains failed and 24v dc lamps are illuminated- MAINS POWER FAILED - BATTERY BACK UP HEALTHY

no lamps illuminated- check fuses and battery connections.

CHARGE RATE SET TO 1A AT 27.2v DC, 15A BLADE FUSE FITTED

ACTUATORS HAVE INTERNAL END STOP LIMIT SWITCHES

ALL RELAYS HAVE MANUAL OVERRIDE & INDICATORS

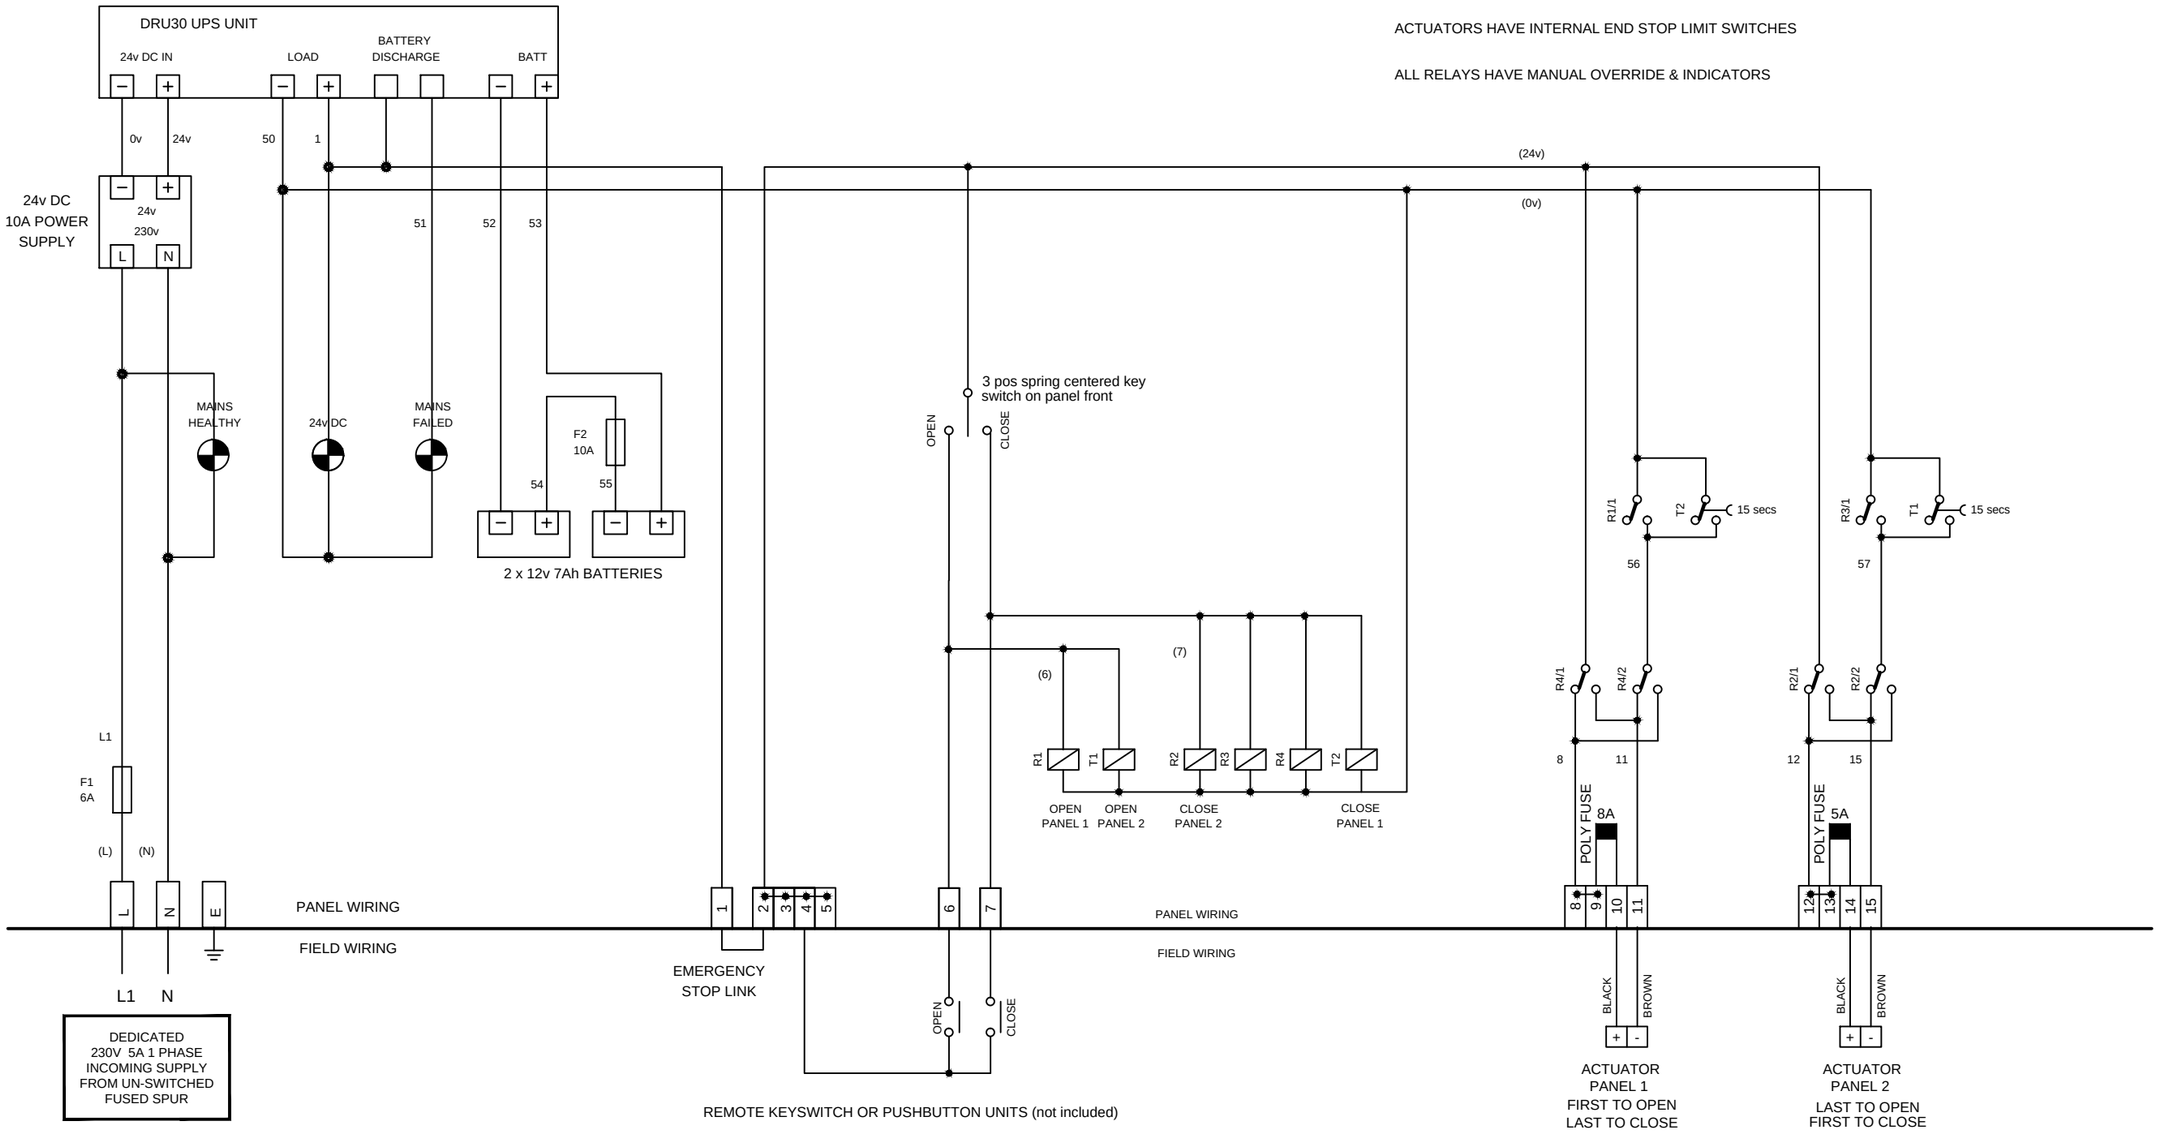

LAST WIRE NUMBER USED = 57

ENCLOSURE IS STEEL
495MM X 400M X 157MM

BEFORE AND DURING ALL MOVEMENTS OF THE ACCESS COVER
ALWAYS ENSURE THAT THE AREA IN WHICH THE COVER WILL MOVE
IS CLEAR OF ALL OBSTRUCTIONS AND PERSONNEL
ALSO ENSURE THAT PANEL OPENING & CLOSING SEQUENCES ARE CORRECT
WHEN OPENING PANEL 1 OPENS FIRST– 15 SECOND DELAY BEFORE PANEL 2 OPENS
WHEN CLOSING PANEL 2 CLOSES FIRST– 15 SECOND DELAY BEFORE PANEL 1 CLOSES
KEYSWITCH MUST BE HELD IN CORRECT POSITION– RELEASING RESETS TIME SEQUENCE
timers can be adjusted to suit

Copyright is claimed in this drawing and no copy may be made without prior written permission ©	The article shown is also the subject of	
	patent rights	V
	registered design right	V
	unregistered rights	V
	The drawing is a design document	V
	patent pending	V

DRAWING MADE BY CAD
MANUAL CHANGES PROHIBITED

ITEM NO	NO OFF	DRG NO.	ITEM MASS	DENOMINATION	MATERIAL	REMARKS
				-		
				-		
				Electrical Circuit		

Existing law protects SURESPAN'S right of possession to this drawing. The design or the drawing must not, without permission of the company, be published, copied, reproduced, manufactured or exploited in any other unauthorized way.

SURESPAN

DRAWN BY	ST
DRAWN DATE	010914

CONTRACT NO.	DRAWING NO.	REV No
STANDARD	SP1185D	B